

# Self-collected HPV test

## Clinpath now an accredited testing facility

Initiatives to improve participation in Cervical Screening have always been a focus of the Australian Cervical Screening Program. To this end, an important new component of the Renewed Cervical Screening Program, which began in Australia on December 1, 2017, was the introduction of a self-collected HPV test.

While only offered to a limited number of women meeting strict funding criteria (see below), the self-collected HPV test will increase participation by offering an acceptable alternative to those women who previously, for many reasons, have not felt comfortable to take part in this important women's health program.

Due to the requirement for the test to be validated by each individual testing laboratory, up until now the self-collected HPV test could only be performed by one Australian laboratory, located in Victoria.

**The requirements for validation have now been completed by our dedicated cervical screening unit and we are pleased to announce our accreditation to carry out the self-collected HPV test.**


### 1 Criteria for offering the self-collected HPV test

The self-collected HPV test is not intended as a routine alternative to clinician-collected cervical samples and should only be offered under the strict guidelines below:

- Patient must be at least 30 years of age.
- Patient must never have been screened or be at least two years overdue for screening (i.e. at least four years since last normal Pap test or seven years since last negative HPV test).
- Patient must decline a vaginal speculum examination.

### 2 Collecting the sample

- The patient must collect the sample in the surgery or healthcare clinic using a red-topped Copan 552C dry FLOQ swab (see below). The swab should be immediately returned to the clinician for referral to the testing laboratory. Patient instruction sheets (see right) are available and can be ordered from our Stores Department.\*
- The self-collected HPV test should not be offered to pregnant women.

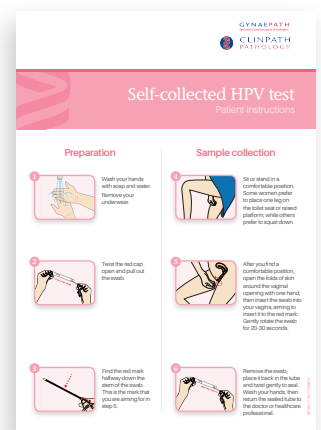


\*Order code D01072 for a pad of 10 sheets

The self-collected HPV test screening pathway differs from that for routine clinician-collected cervical samples and is shown overleaf.

For further information, please contact Business Development on (08) 8366 2020 or email [busdev@clinpath.com.au](mailto:busdev@clinpath.com.au)

# Screening pathway for self-collected samples

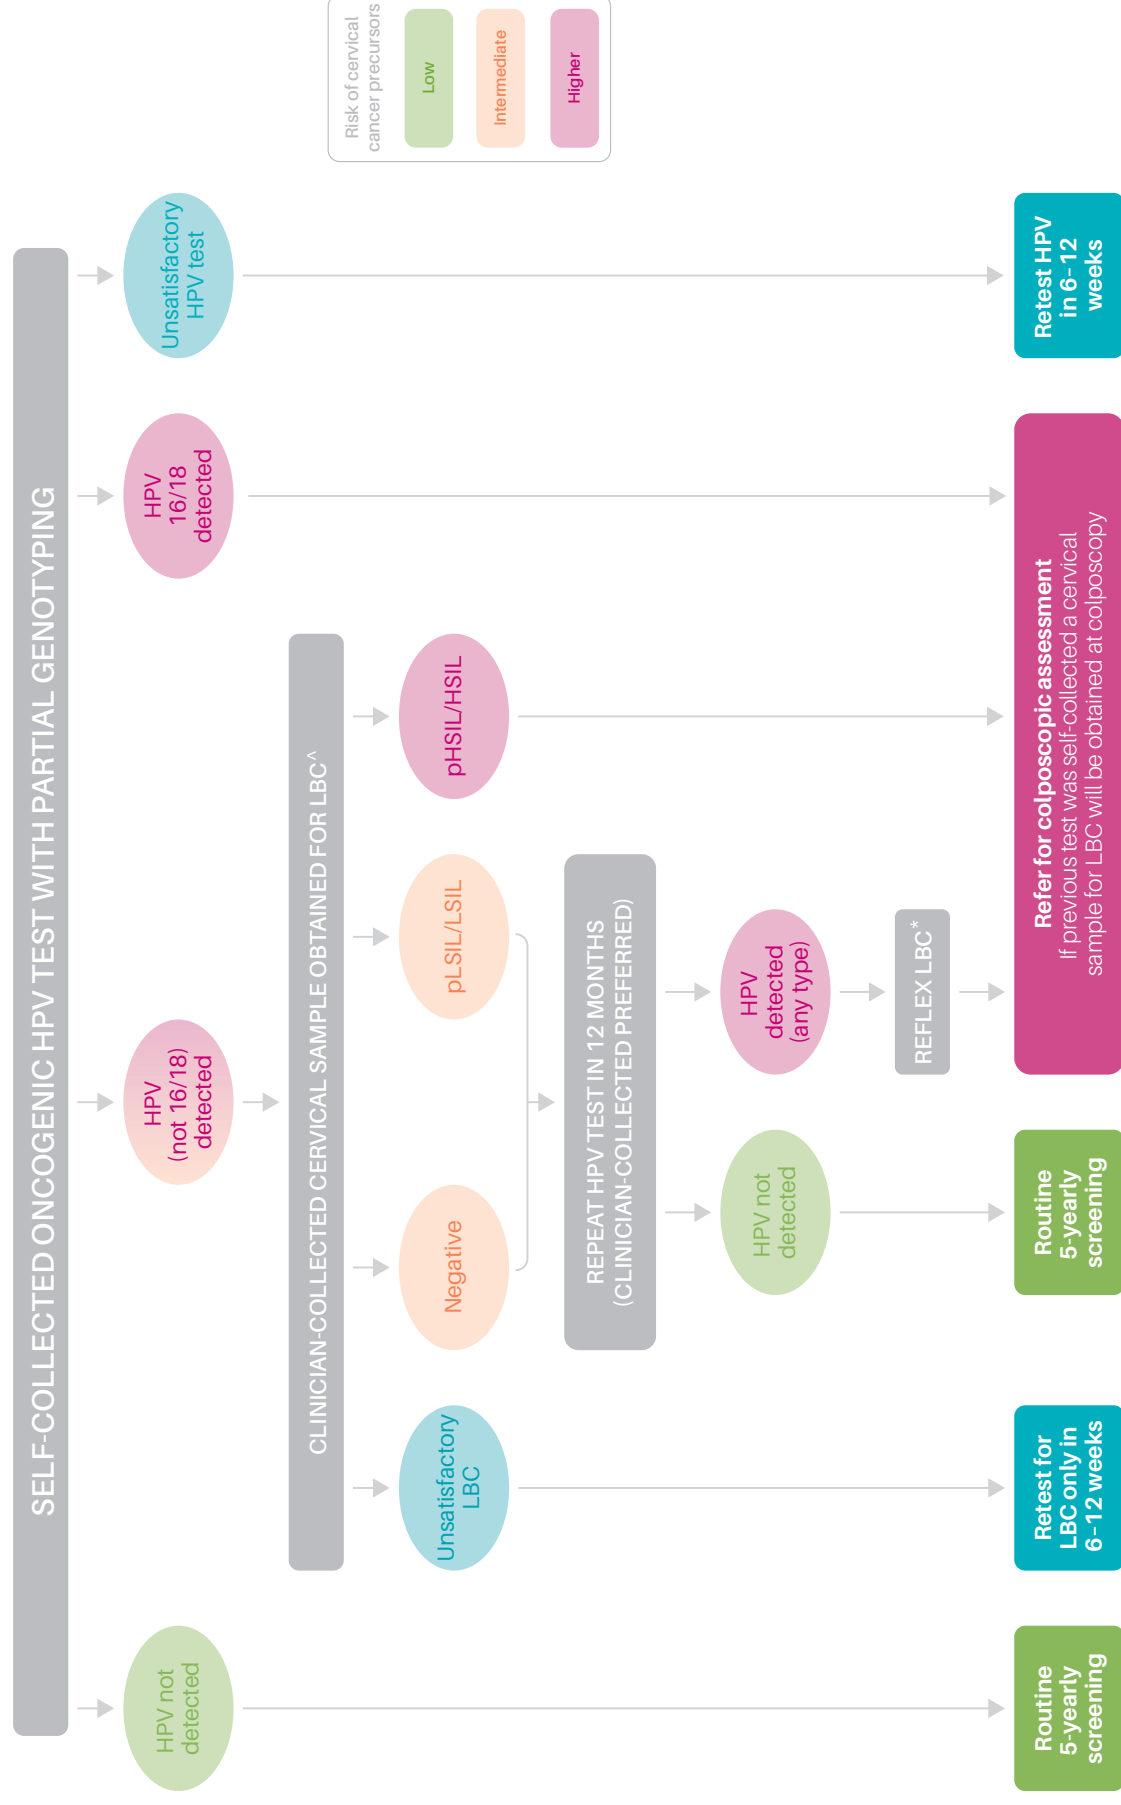

^ Healthcare professional visit required

\* Reflex LBC can only be performed if repeat HPV test was a clinician-collected cervical sample

Adapted from: National Cervical Screening Program: Guidelines for the management of screen-detected abnormalities, screening in specific populations and investigations of abnormal bleeding, Cancer Council Australia, Sydney (2016)